


KEYED NOTES:

- # SYMBOL USED FOR NOTE CALLOUT.
- 1. SEE MECHANICAL PLANS AND SCHEMATIC ON SUPPLY WELL FOR THE BUILDINGS HVAC SYSTEM. SUPPLY WELL SHALL BE RATED FOR 200 GPM AND 20 PSI PRESSURE BETWEEN THE INLET AND OUTLET OF THE BUILDING. ROUTE 4" WWS LINE FROM THE SUPPLY WELL TO THE BUILDING SEE SHEET M11.1 FOR CONTINUATION. SEE CIVIL SITE PLAN FOR ADDITIONAL INFORMATION.
- 2. INJECTION WELL FOR THE BUILDINGS HVAC SYSTEM. INJECTION WELL SHALL BE RATED TO ACCEPT 200 GPM WITHOUT EXCESSIVE BACK PRESSURE (20 PSI MAXIMUM) FROM THE SUPPLY WELL. ROUTE 4" WWR FROM THE BUILDING TO THE INJECTION WELL TO THE BUILDING SEE SHEET M11.1 FOR CONTINUATION. SEE CIVIL SITE PLAN FOR ADDITIONAL INFORMATION.



Ron Joseph
principal architect
c/o 816 W. Francis
#434
Spokane, Washington
(99205)
509-468-1239
design-response@comcast.net

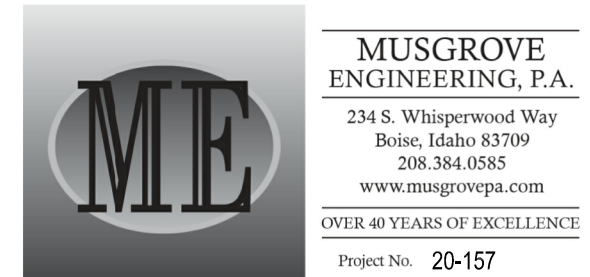

THE PHILOMENA BUILDING
SPOKANE, WASHINGTON
PHILOMENA, LLC

NO.	DATE	REVISIONS

DRAWN BY: TDN
CHECKED BY: TDN
DATE: 04/18/2020
PROJECT NO.

SHEET NO.
M1.0

MECHANICAL SITE PLAN
SCALE: 1" = 20'-0"

